



SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale



**IIP 13 –  
3 Pallets**





SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale







# SLE 23-032 Electrical Sale



**Hammond Power Solutions**  
Guelph, ONT  
Compton, CA

## HPS Sentinei™ G

Energy Efficient Distribution Transformer  
Transformateur de Distribution à Bon Rendement Énergétique

Baraboo, WI  
Monterrey, MX

**Part No. SG3A0045KV**

LI 3902  
DRY TYPE TRANSFORMER  
E112313  
LISTED

ALSO VERIFIED IN ACCORDANCE TO ENERGY STANDARD CRO2 2-19 BY UNDERWRITERS LABORATORIES INC.

Cust. Ref. / Ref. du Client	Serial No. / No. de Serie	<b>BB01331072</b>				
Phase	HV/HT	<b>3</b>	<b>480V</b>	<b>54.1A</b>		
Type	BIL	<b>K</b>	<b>10 kV</b>			
Cooling / Refroidissement	Term Bornes	<b>ANN</b>	<b>H1 H2 H3</b>			
kVA	LV/BT	<b>45</b>	<b>220Y/127V</b>	<b>118A</b>		
Temp. Rise / Échauffement	BIL	<b>150 °C</b>	<b>10 kV</b>			
Temp Class / Classe Temp	Term Bornes	<b>220 °C</b>	<b>X0 X1 X2 X3</b>			
Winding / Enroulement	Energy Regulations / Règlements de Energetique	<b>AL</b>	<b>DOE 10 CFR PART 431:2016</b>			
Frequency / Frequence Hz		<b>60</b>	<b>CEE ACT SOR/2018-201</b>			
Impedance % / #		<b>170 °C</b>	<b>3.8</b>			
Encl Type / Type De Coilage		<b>3R</b>				
Weight / Poids		<b>420/191</b>				

VOLTS	CURRENT COURANT	% RATED VOLTAGE % TENSION NOMINALE	CONNECTION EACH PHASE CONNEXION PAR PHASE
504	51.5	105	1
492	52.8	102.5	2
480	54.1	100	3
468	55.5	97.5	4
456	57.0	95	5
444	58.5	92.5	6
432	60.1	90	7


SPACINGS BETWEEN ANY VENTILATED ENCLOSURE PANEL AND ANY ADJACENT WALL SHALL BE A MINIMUM OF 3 INCHES

SERAMIC QUALIFICATIONS:  
OSP-0136-10RMC 2016/04/02 7-15  
SDR <= 2.0g 2R=1 Ip=1.5  
G23ME






## SLE 23-032 Electrical Sale

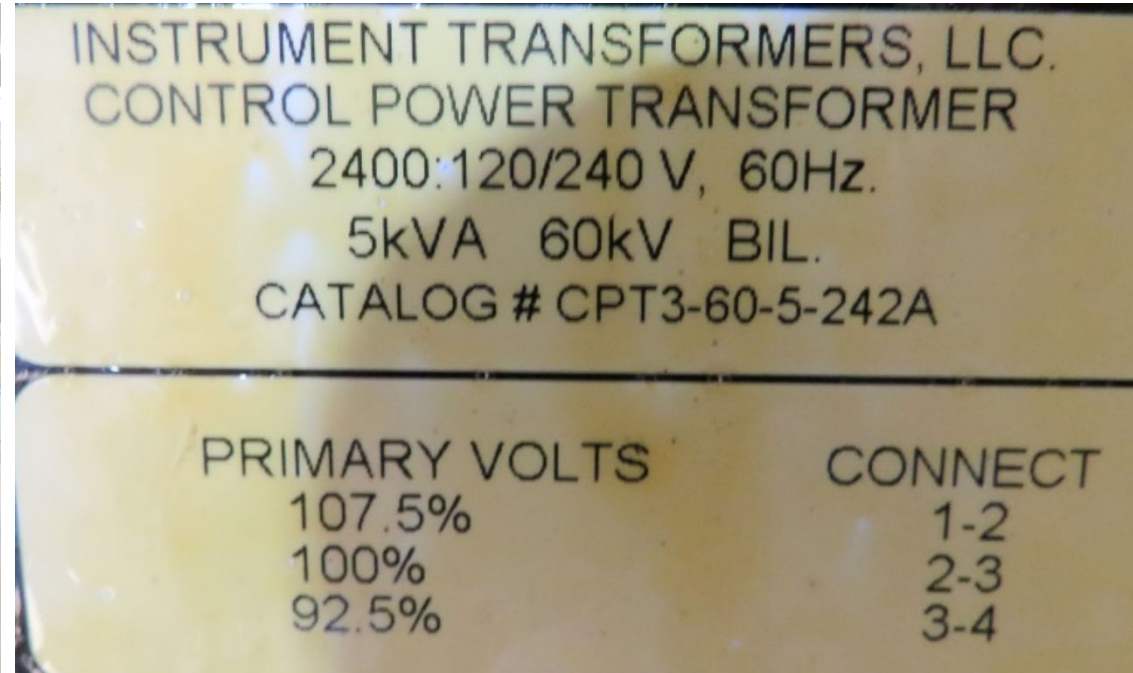





# SLE 23-032 Electrical Sale

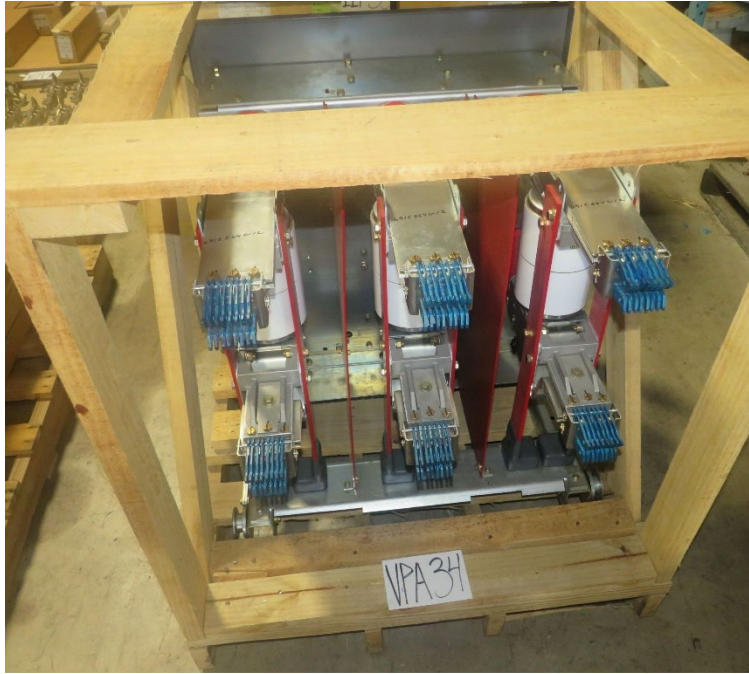





SLE 23-032 Electrical Sale







SLE 23-032 Electrical Sale







## SLE 23-032 Electrical Sale

